



PAVEMENT OR STREET CROSSING

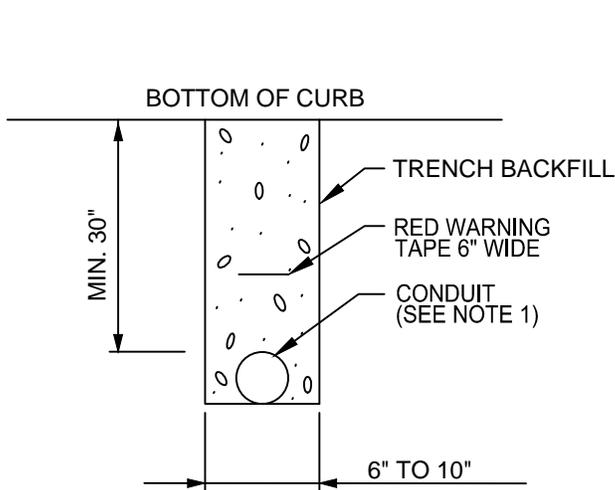

ELECTRIC CONDUIT UNDER PAVEMENT

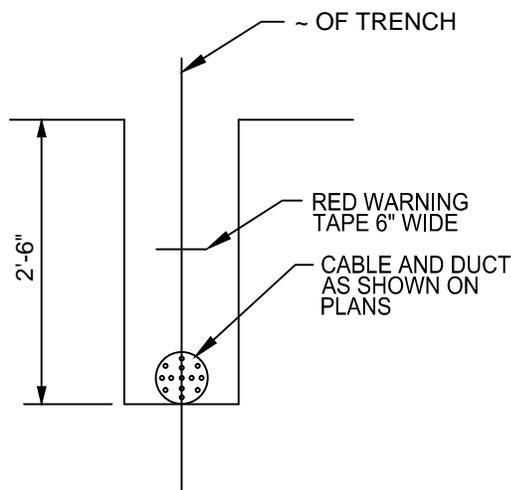

TRENCH CROSS SECTION

NOTES:

1. ELECTRICAL SERVICE CONDUIT SHALL BE 2" OR 2 1/2" RIGID GALVANIZED STEEL.
2. CONCRETE ENCASED SCH 80 PVC CONDUIT SLEEVES SHALL BE INSTALLED UNDER DRIVEWAY AND ROAD CROSSINGS FOR BRANCH CIRCUITS. SLEEVES SHALL EXTEND A MINIMUM OF 2 1/2 FEET BEYOND THE BACK OF CURB AND HAVE A MINIMUM OF 3" CONCRETE COVER.

VILLAGE OF NEW LENOX  
STANDARD DETAIL  
FOR TYPICAL  
CONDUIT INSTALLATION

REV:	1
DATE:	JANUARY 2018
FILE:	TRANS/CONDUIT/INSTAL