


NOTES:

1. ECCENTRIC CONE REQUIRED
2. USE 4'-0" DIAMETER FOR WATER MAIN SIZES 8" OR LESS, USE 6'-0" DIAMETER FOR WATER MAIN SIZES 10" THRU 12", FOR WATER MAIN SIZES GREATER THAN 12" THE VAULT SIZE WILL BE DETERMINED AT PLAN REVIEW.

ALL MATERIALS MUST BE "MADE IN USA".

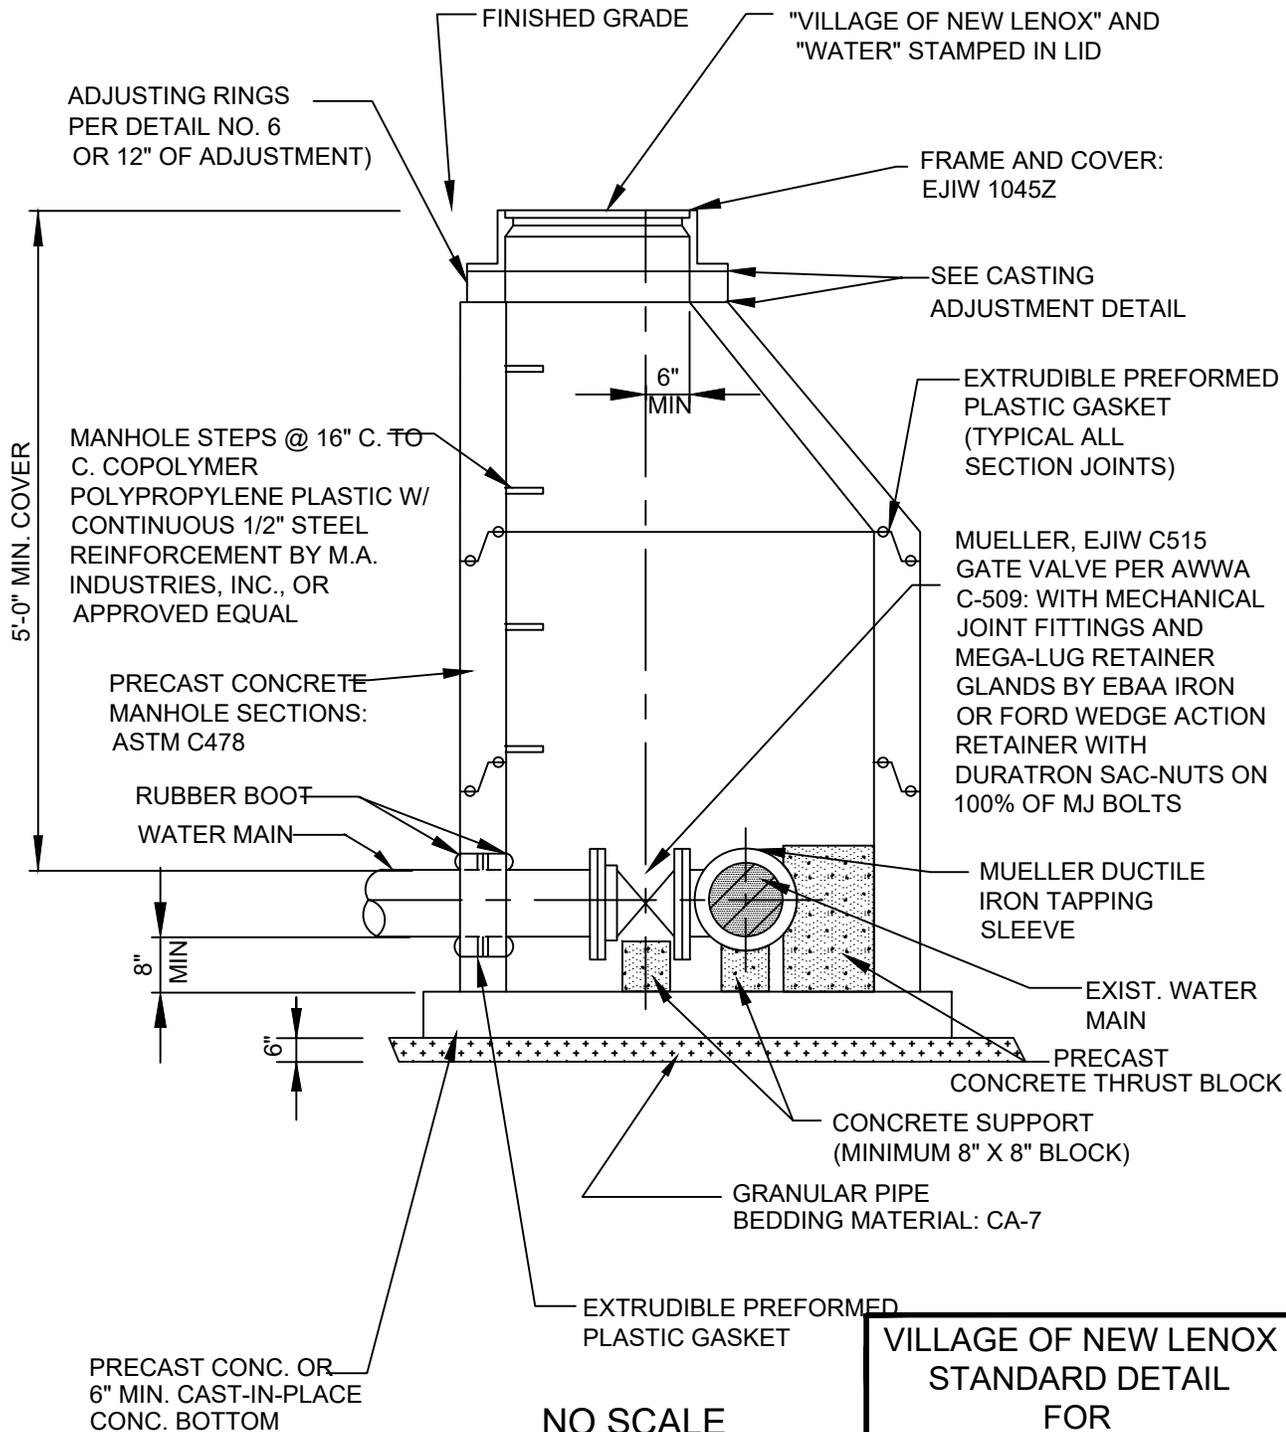

**NO SCALE**

VILLAGE OF NEW LENOX  
STANDARD DETAIL  
FOR  
PRESSURE CONNECTION  
VALVE VAULT

NOTE:  
TAPPING OF WATER MAINS SHALL BE DONE ONLY IN THE PRESENCE OF AN AUTHORIZED VILLAGE REPRESENTATIVE. 48 HOUR NOTICE MUST BE GIVEN.

REV:	8
DATE:	MAY 2025
FILE:	WATER\PCVAVT